

H-Bridge Hybrid Modular Converter (HBHMC) for High-Voltage Direct Current (HVDC) Applications: Modulation Strategies, Control, and Experimental Validation

T. Bhavani¹, P. Venkaiah¹, J. Suresh¹

¹Assistant Professor, Dept. of EEE, Malla Reddy Engineering College and Management Sciences, Medchal, Hyderabad, India

Abstract

An H-bridge hybrid modular converter (HBHMC) is proposed for high-voltage direct current (HVDC) applications. At the output of the main H-bridge converter, it has a wave-shaping circuit made up of full-bridge submodules (FBSMs) that are connected in series. For a three-phase system, three HBHMCs are connected either in series (series-HBHMC) or in parallel (parallel-HBHMC) across the dc-link. The operating modes of HBHMC, novel modulation strategies for voltage balancing of FBSMs, and control of HBHMC-based HVDC systems are presented in this paper. A detailed comparison between HBHMC and other hybrid topologies is performed on the basis of the required number of switches and capacitors. The HBHMC has the features of dc fault blocking capability, a lower footprint structure, and an extra degree of freedom for submodule capacitor voltage balancing. The HBHMC-based HVDC system works well for both balanced and unbalanced three-phase grids, and it can handle faults, as shown by PSCAD simulation studies. Also, the proposed converter's ability to work in normal and dc fault situations is tested, along with the proposed capacitor voltage control scheme. This is done by using a three-phase grid-connected HBHMC laboratory prototype.

1. INTRODUCTION

CERN, the European Organization for Nuclear Research, conducts research open to international co-operation in the field of physics concerning high-energy particles. To this direction, special attention is paid to the design of the equipment supporting the experiments. The particles' acceleration necessitates controlled magnetic fields. Power electronics are an essential component of the experimental setup due to the fact that they control with precision the current supplied to the electromagnets of the accelerators. The demanding applications of power electronics in the experiments lead the Electrical Power Converter (EPC) group to further develop the power electronic converters for future accelerators. One of the responsibilities of the EPC group is the power supply of the Proton Synchrotron Booster (PS Booster). PS Booster is a circular accelerator and it accelerates beams of protons from the energy of 50MeV up to 1.4 GeV. It is a part of the accelerator chain at the CERN Large Hadron Collider, see figure 1.1. The future upgrade of the PS Booster aims to accelerate the beams up to the energy of 2 GeV. The load specifications for the upgrade of the PS Booster are used as an example to test the capability of the converter.

The aim of this master thesis is to: To examine the state of the art in the MMC design and control

- To compile a design guideline for the design sizing of the MMC as an AFE
- To evaluate a voltage balancing control method
- To evaluate the overall performance of the topology in an AFE application

2. H-BRIDGE HYBRID MODULAR CONVERTER

A. Single-phase configuration

The proposed single-phase HBHMC is shown in Fig. 1. Like other HMCs discussed in the previous section, this converter also has two main parts, a MHBC and WSC. The MHBC consists of four switches (DSx1-DSx4), which are series connection of fully controllable semiconductor switches to withstand high per phase dc-link voltage (V_{dcx}). These switches are operated at the fundamental

frequency. The switches of MHBC directs the current either to the positive dc terminal, negative dc terminal, or it freewheels either through DSx1 and DSx2 or through DSx3 and DSx4. To generate sinusoidal output voltage across the load, the WSC is used at the output of MHBC. The WSC is a series connection of FBSMs and these are switched at a higher frequency. The WSC is responsible for the multilevel converter output voltage waveform generation with very low distortion. The output voltage states of the MHBC can be either +VdCx, 0, or -VdCx. For simplicity only two FBSMs are considered to be connected in series with MHBC as shown in Fig. 1. If the voltage of each FBSM capacitor is regulated to VdCx/2, five output voltage (Vx) levels (+VdCx, +VdCx/2, 0, -VdCx/2, and -VdCx) can be obtained. The different switching states for generating five voltage levels and the corresponding states of capacitor voltages are summarized in indicate charging, →, and ↓, ↑. These states give an extra degree of freedom for the capacitor voltage balancing of WSC in HBHMC. This is because, for the same direction of current and for a given voltage level output, the SM capacitors can be either charged or discharged in the desired manner. This degree of freedom is not present in the existing HCMC. Moreover, the HBHMC provides full dc bus utilization compared to the HCMC topology, which utilizes only half of the dclink voltage.

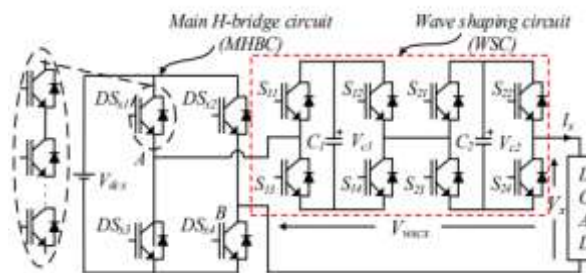


Fig. 1 Block diagram of single-phase HBHMC.

B. Three-phase configuration

To obtain the three-phase output, three HBHMCs (Fig. 1) can be connected either in series (series-HBHMC) or in parallel (parallel-HBHMC). (Figs. 2 (a) and (b)). The three MHBCs of the three-phase converter operate at the fundamental frequency with 120° phase displaced outputs with respect to each other. For series-HBHMC, three separate dc capacitors are required to equally divide the total dc-link voltage (Vdct) such that 3VdCx = Vdct (Fig. 2 (a)).

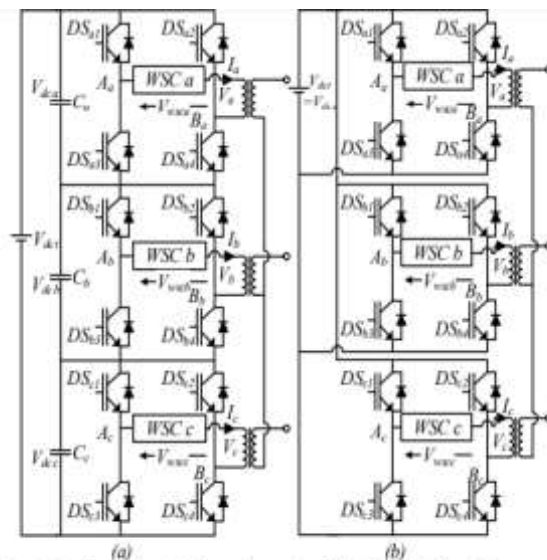


Fig. 2 (a) Illustration of a three-phase series H-bridge hybrid modular converter (series-HBHMC), (b) illustration of a three-phase parallel H-bridge hybrid modular converter (parallel-HBHMC).

For series-HBHMC, the MHBC outputs are either +Vdct/3, 0 or -Vdct/3, and for the parallel-HBHMC the outputs are +Vdct, 0 or -Vdct (Figs. 2(a) and 2(b)). For an N number of series connected

FBSMs per phase in WSC, the series-HBHMC capacitor voltage of each SM is regulated to $V_{dct}/3N$, and in the parallel-HBHMC it is regulated to V_{dct}/N . These converters are connected to an ac network through three units of single-phase transformers. These transformers are used to provide isolation between the three-phase outputs of the converter and to match the ac and dc voltage levels. As three separate transformers are used for each phase, it eases the shipment of transformers and also reduces the spare holding requirements. These are important considerations for HVDC applications. As the series-HBHMC uses $1/3$ of V_{dct} for each phase, it is more suitable for the applications like tapping of existing HVDC lines, where the dc-link voltage is high and current is low. The parallel-HBHMC uses full V_{dct} for each phase. Hence it is more suitable for applications requiring high current with low dc-link voltage like back to back HVDC system and medium voltage dc transmission system.

C. Modes of operation

The normal steady-state HBHMC operation can be categorized into two operating modes depending on the MHBC switching states as explained below. 1) Powering Mode: In powering mode, the output of MHBC is a square wave and the WSC is responsible to obtain the multilevel output voltage waveform from the output of HBHMC. In this case, the dc-link is connected to load through WSC and it supplies power to both WSC and load. This mode is termed as powering mode because the energy is exchanged between the dc-link and the ac system. In this mode, for the positive half-cycle of output voltage DSx1 is on and DSx2 is off, and for the negative half-cycle DSx1 is off and DSx2 is on. Here, x represents phase-a, b, or c. In this mode, the phase-x converter output voltage (V_x) depends on the perphase dc-link voltage (V_{dcx}) and the voltage across WSC (V_{wscx}). For series-HBHMC, $V_{dcx} = V_{dct}/3$ and for parallel-HBHMC, $V_{dcx} = V_{dct}$.

4. RESULTS

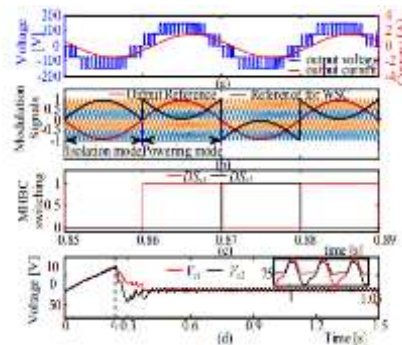


Fig. 3 Waveforms of HBHMC using HCI method (a) Output voltage and current waveforms, and (b) Modulation signals for HCI method, (c) switching signals of MHBC, and (d) individual capacitor voltages of WSC.

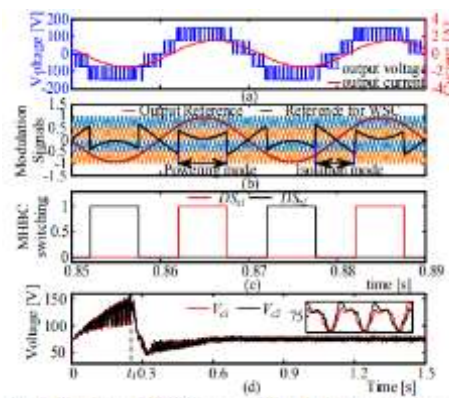


Fig. 4. Waveforms of HBHMC using AZCI method (a) output voltage and output current waveform, (b) Modulation signals for ACZI method, (c) switching signals of MHBC, and (d) Individual capacitor voltages of wave shaping circuit

5. CONCLUSION

This paper proposes an H-bridge hybrid multilevel converter topology, HBHMC, for HVDC applications. The proposed converter is a dc fault tolerant hybrid topology, which uses cascaded FBSMs (i.e. WSC) connected to the output of the MHBC. The WSC helps in generating the multilevel voltage waveform at the HBHMC output. For a three-phase circuit, three such HBHMCs can be connected in series on the dc side to handle a high dc-link voltage. Similarly, they can instead be connected in parallel across the dc-link for high dc current. In this paper, the basic operation of HBHMC and new modulation techniques to balance the capacitor voltages of HBHMC by appropriately selecting an operating mode (isolation mode: HCI and AZCI methods) are presented. The suggested voltage control methods are simple and easy to implement. Moreover, both the HCI and the AZCI methods are designed in a way that the MHBC always operates at the fundamental frequency to reduce the switching losses of converter. Further, the AZCI method offers more advantages than the HCI method, such as, smaller value of submodules capacitance and ability to operate in the overmodulation mode. Some of the other prominent advantages of the proposed converter are: (i) extra degree of freedom for capacitor voltage balancing, (ii) fewer semiconductor devices and capacitors in series-HBHMC, (iii) higher dc-link utilization in parallel-HBHMC, and (iv) inherent dc fault current blocking capability. Simulation and experimental studies are performed to validate the proposed converter topology and capacitor voltage control methods.

REFERENCES

- [1] A. Lesnicar and R. Marquardt, "An innovative modular multilevel converter topology suitable for a wide power range," in Proc. Power Tech Conf., 2003, Vol. 3, pp.1-6.
- [2] S. Allebrod, R. Hamerski, and R. Marquardt, "New transformerless, scalable modular multilevel converters for hvdc-transmission," in Proc. IEEE Power Electron. Specialists Conf., 2008, pp. 174–179.
- [3] J. Dorn, H. Huang, and D. Retzmann, "Novel voltage sourced converters for hvdc and facts applications," in Proc. CIGRE, Osaka, Japan, 2007.
- [4] R. Marquardt, "Modular multilevel converter: an universal concept for hvdc-networks and extended dc-bus-applications," in Proc. Int. Power Electron. Conf., 2010, pp. 502–507. [5] L. X. Tang and B. T. Ooi, "Locating and isolating dc faults in multiterminal dc systems," IEEE Trans. Power Del., vol. 22, no. 3, pp. 1877-1884, Jul. 2007.
- [6] R. Marquardt, "Modular multilevel converter topologies with dc-short circuit current limitation," in Proc. IEEE Power Electron. And ECCE Asia, 2011, pp. 1425-1431.
- [7] J. Yang, J. E. Fletcher and J. O. Reilly, "Short-circuit and ground fault analyses and location in VSC-based dc network cables," IEEE Trans. Ind. Electron., vol. 59, no. 10, pp. 3827-3837, Oct. 2012.
- [8] K. Friedrich, "Modern HVDC PLUS application of VSC in modular multilevel converter topology," in Proc. IEEE Int. Symp. Ind. Electron., 2010, pp. 3807-3810.
- [9] C. M. Franck, "HVDC circuit breakers: a review identifying future research needs," IEEE Trans. Power Delivery, vol. 26, no. 2, pp. 998- 1007, April 2011.
- [10] X. Q. Li, Q. Song, W. H. Liu, H. Rao, S. K. Xu and L. C. Li, "Protection of nonpermanent faults on dc overhead lines in MMC-based HVDC systems," IEEE Trans. Power Delivery, vol. 28, no. 1, pp. 483-490, Jan. 2013